KEYED NOTES	
1	RETURN AIR DUCT UP TO UNIT, PROVIDE TRANSITION AS REQUIRED TO MAKE UNIT CONNECTION.
2	SUPPLY AIR DUCT UP TO UNIT, PROVIDE TRANSITION AS REQUIRED TO MAKE UNIT CONNECTION.
3	ROUTE CONDENSATE DRAIN LINE FROM UNIT TO LAVATORY TAILPIECE.
4	ROUTE DUCT UP TO EXHAUST FAN ON ROOF. PROVIDE TRANSITION AS REQUIRED TO MAKE CONNECTION TO FAN.
5	DRYER VENT OUT THRU SIDEWALL. PROVIDE WALL CAP SIMILAR TO SEIHO SFZ.

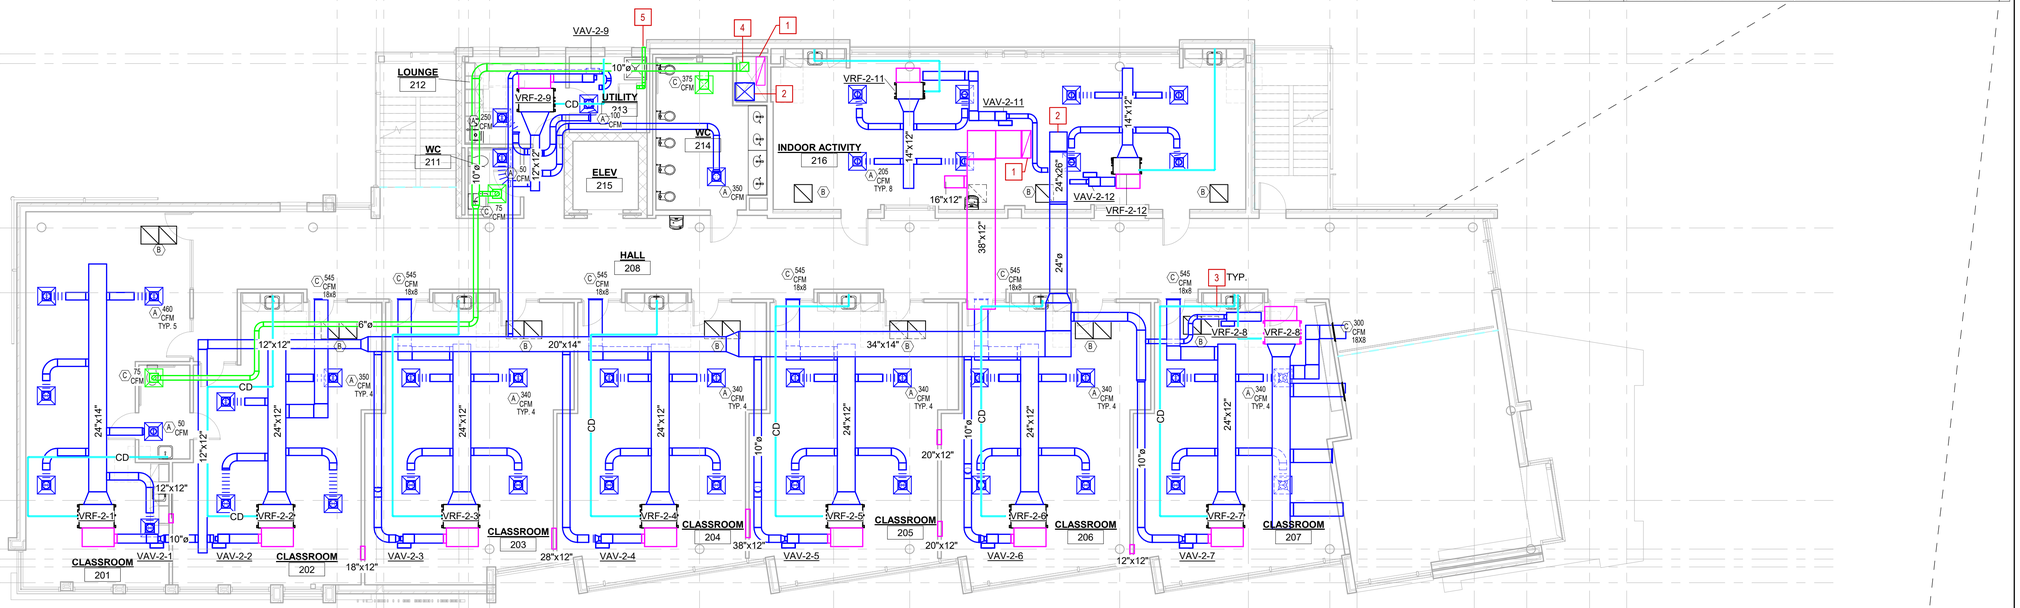

FLOOR PLAN - LEVEL 2 - HVAC 2
1/8" = 1'-0"

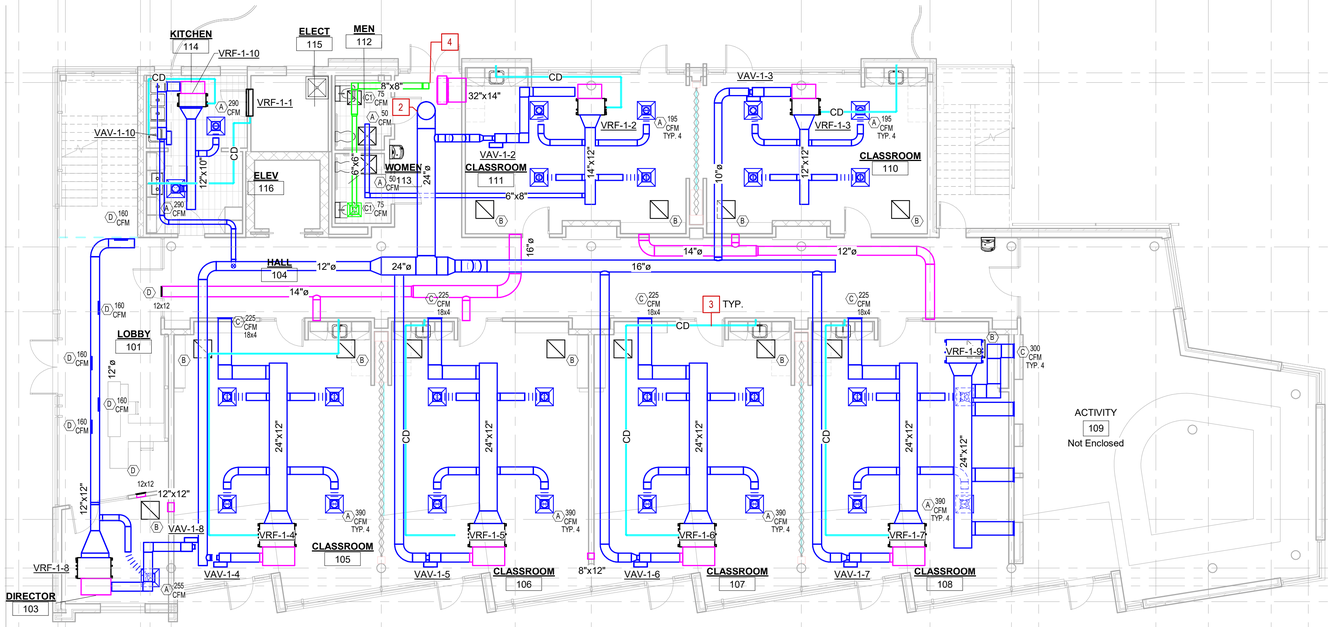

FLOOR PLAN - LEVEL 1 - HVAC 1
1/8" = 1'-0"

O 281 410 1349
www.wsquaredarch.com

w [squared] architects

GK ENGINEERS, LLC
TEXAS-REG # F-18854
5959 W. LOOP SOUTH, SUITE 385
BELLAIRE, TX 77096
PH: 832.250.1966
PH: 713.208.0964

ISSUES AND REVISIONS

NO	DATE	DESCRIPTION
	07-22-2019	ISSUED FOR PERMIT
	08-16-2019	ISSUED FOR BID
1	08-26-2019	ADDENDUM 2

STATE OF TEXAS
DAVIA ANN GERNAND
109903
LICENSED
PROFESSIONAL ENGINEER
26 AUG 2019

GH SCHOOL
4724 N MAIN STREET

SHEET TITLE
FLOOR PLAN - LEVEL 1 & 2 - HVAC

SHEET NUMBER
M201

PROJECT # 19.02

©2019 W SQUARED DESIGN, INC.
Architect shall own the overall conceptual design prepared and developed for the project on the intangible exclusive rights or copyright therein.

C:\Users\Davia Gernand\Documents\1902-GHS-190517-MODEL_R18_GK_MEP-Latest_W.KLUESNER@GK-MEP.COM.rvt
8/26/2019 4:50:30 PM